



2024 Annual Water Quality Report Summary

City staff ensure high-quality drinking water is delivered with maximum efficiency to residential, industrial, commercial, and institutional customers. We operate and maintain:

					
Two re-chlorination stations that boost disinfection	Nine residual chlorine analyzers that monitor disinfection	Three pump stations that have a combined 1,300 horsepower	Three reservoirs that can store over 11.5 million litres of water	15 pressure reducing valve stations	More than 600 fire hydrants

We analyzed 705 water samples

Drinking water in Port Moody met or exceeded the requirements of both the Guidelines for Canadian Drinking Water Quality and the British Columbia Drinking Water Act and Regulation.

The City's water system is monitored, operated, and maintained by a team of qualified personnel who are certified by the Environmental Operators Certification Program and the Applied Science Technologists and Technicians of British Columbia. Our water distribution system is certified as a Level III facility by the Environmental Operators Certification Program.

We purchased 5.14 million cubic metres of water from Metro Vancouver – the equivalent of 2,056 Olympic Swimming Pools – at a cost of \$4.8M.

As part of our maintenance program, we:			
	Flushed 57kms of the City's water distribution system	Remotely monitored the water distribution system 24/7/365	managed a water distribution system worth \$26,806,868

We repaired 3 significant water main breaks within the city. San Remo Dr, Clarke St and 600 loco Rd

Operations Division
Engineering & Operations
☎ 604.469.4574
✉ operations@portmoody.ca

PORT MOODY
CITY OF THE ARTS



2024 Annual Water Quality Report



Engineering and Operations

Operations Division

City of Port Moody

PORT MOODY
CITY OF THE ARTS

Foreword

According to the British Columbia Drinking Water Protection Act and the British Columbia Drinking Water Protection Regulation (BCDWPA and BCDWPR), the City of Port Moody is required to conduct drinking water quality monitoring and to publish the results in an annual report. A summary of water quality, and an overview of projects and events related to drinking water in the City of Port Moody, is provided in this report.

Please visit the following websites for further information:

- Health Canada
<http://www.hc-sc.gc.ca/ewh-semt/water-eau/drink-potab/guide/index-eng.php>
- Ministry of Health
<https://www2.gov.bc.ca/gov/content/governments/local-governments/infrastructure/water-systems>
- Metro Vancouver
<http://www.metrovancouver.org/services/water/Pages/default.aspx>

Emergency Contact Information

Kyle Gregory

Operations, Superintendent – Utilities

Phone: 604-469-4687

E-mail: kgregory@portmoody.ca

Operations Customer Service

Phone: 604-469-4574

Fax: 604-469-4530

E-mail: operations@portmoody.ca

**Jeff Little, AScT, RTMgr, PTech,
CPWI 3**

Manager of Operations

Phone: 604-469-4604

E-mail: jlittle@portmoody.ca

Table of Contents

2024 Annual Water Quality Report	ii
Acronyms & Definitions	7
Executive Summary	8
1.0 Water Distribution System	9
1.1 System Infrastructure	9
1.2 Facility Classification	9
1.3 Water Distribution System Emergency Response & Contingency Plan... ..	10
1.4 Staff Certification	10
2.0 2024 Event Summary	10
2.1 Water Main Breaks	10
2.2 Metro Vancouver Drinking Water Conservation Plan Summer Support Program	11
2.3 Regional Water Restrictions	11
2.4 Variance from Drinking Water Sample Collection Fee for Service Agreement	12
2.5 Water Quality Customer Service	13
3.0 Water Main Flushing Program	13
4.0 Water Quality Sampling and Testing	13
4.1 Chemical and Physical Quality	14
4.1.1 Metals	14
4.1.2 Disinfection By-Products	14
4.1.3 Vinyl Chloride	14
4.2 Bacteriological Quality	15
4.3 Chlorine Residual	17
5.0 Water Distribution System Projects	18
6.0 Conclusion	18
References	19
Appendix #1	20
Appendix #2	37
Appendix #3	39
Appendix #4	41
Appendix #5	43

List of Tables

Table #1: Water Distribution System Assets	9
Table #2: Water Main Breaks	10
Table #3: Number of Samples Collected by Month	12
Table #4: Chemical and Physical Monitoring Frequency.....	14

List of Figures

Figure #1: Number of Bacterial Samples Analyzed per Month	16
Figure #2: 2024 Monthly Heterotrophic Plate Count Results >500 CFU/mls.....	16
Figure #3: Results of Bacteriological Analysis of Potable Water Samples and Compliance with BCDWPR.....	17

Acronyms & Definitions

Acronym	Full Form	Definition
AO	Aesthetic Objective	Targeted levels of characteristics that do not result in objectionable qualities like taste, odour, or appearance
ASTTBC	Applied Science Technicians and Technologists of British Columbia	Body responsible for regulating standards of practice and training of technologists in the interest of the public
BCDWPA	British Columbia Drinking Water Protection Act	Act that establishes requirements for safe supply of drinking water
BCDWPR	British Columbia Drinking Water Protection Regulation	Regulation that prescribes specific actions and measurements related to the safe supply of drinking water
DBP	Disinfection by-products	Group of chemicals generated when chlorine used for drinking water disinfection that includes HAA and THM
E.coli	Escherichia coli	Large classification of bacteria commonly found in the natural environment, including in food and digestive tracts
EOCP	Environmental Operators Certification Program	Industry body legislatively required to conduct certification of water distribution system operators
GCDWQ	Guidelines for Canadian Drinking Water Quality	Document established through a collaborative provincial-federal committee that sets out limits for drinking water characteristics
HAA	Haloacetic Acid	Disinfection by-products
HPC	Heterotrophic Plate Count	Measurement of the overall amount of bacteria in drinking water
MAC	Maximum Acceptable Concentration	Highest tolerated amount of a characteristic in drinking water
Mg/l	Milligrams per Litre	A ratio that expresses the mass of a substance per litre of water
NTU	Nephelometric Turbidity Units	Measurement of light passing through water that indicates its appearance and presence of suspended particles
PPB	Parts Per Billion	A ratio that expresses a quantity of a characteristic amongst 1000 million units of drinking water
PPM	Parts Per Million	A ratio that expresses a quantity of a characteristic amongst 1 million units of drinking water
PRV	Pressure Regulating Valve	A valve used to regulate or reduce operating pressure in the water distribution system
PVC	Polyvinyl Chloride	Commonly used plastic pipe material
SCADA	Supervisory Control and Data Acquisition	Electronic system used for remote communication and control of water distribution system infrastructure
THM	Trihalomethane	Disinfection by-products
UDF	Uni-directional Flushing	A method used to clean pipes in the water distribution system

Executive Summary

The City of Port Moody supplies drinking water to residential, industrial, commercial, and institutional customers within City limits. In 2024, the City purchased and distributed almost 5.14 million cubic metres of treated drinking water with a value of over \$4.8 million.

This report fulfills the requirements of the City set out in the British Columbia Drinking Water Protection Act (BCDWPA) by providing an overview of the City's water distribution system and assessment of key performance indicators. Metro Vancouver collects and analyzes water samples from the City's distribution system on behalf of the City of Port Moody. This report includes a summary and discussion of these results, and a complete record of 2024 water quality sampling results.

The sampling that Metro Vancouver conducts on behalf of the City analyzes chemical, physical, and bacterial parameters. The sample results for Port Moody's water were below their respective Maximum Acceptable Concentration (MAC) values, with the exception of three separate incidences.

As part of its commitment to continual improvement, reliable service, and a high level of water quality, the City completes operational and capital improvement programs on an ongoing basis. These programs are continually evaluated and adjusted to ensure that high-quality drinking water is delivered with maximum efficiency.

A summary of notable incidents related to the water distribution system is outlined in Section 2.0.

1.0 Water Distribution System

1.1 System Infrastructure

The tables in this section provide a snapshot of the City of Port Moody's water distribution system. All of the components listed are operated and maintained by City of Port Moody staff.

Table #1: Water Distribution System Assets

Appurtenance	Quantity
Total length of all water mains	Approximately 120km
Fire Hydrants	Approximately 600
Pressure Regulating Valve (PRV) Stations	15
Pump Stations	3
Reservoirs	3
Rechlorination Stations	2
Residual Chlorine Analyzers	9

There are many other smaller components to Port Moody's water distribution system, including:

- water meters;
- air valves;
- blowdown chambers;
- line valves;
- sampling stations; and
- automatic flushing units.

All of these components work together to distribute safe, high-quality drinking water throughout the City. As of December 31, 2024, the net book value of all these components, which together comprise the City's water distribution system, was \$26,521,048.

1.2 Facility Classification

The City of Port Moody's water distribution system is classified by the Environmental Operators Certification Program (EOCP) as a Class III facility, which is the second-most complex category of facilities. This classification will be reviewed by the EOCP again in 2026 to determine if changes to operating parameters, additional infrastructure, or changes in demand have impacted the complexity of the water distribution system.

1.3 Water Distribution System Emergency Response & Contingency Plan

The City completed an interim Water Distribution System Emergency Response & Contingency Plan in advance of the preparation of a comprehensive emergency and business continuity plan to be completed before 2026.

1.4 Staff Certification

The City's water system is monitored, operated, and maintained by a team of qualified personnel who are certified by the EOCP and the Applied Science Technologists and Technicians of British Columbia (ASTTBC). Port Moody's water distribution system is classified as a Class III system by the EOCP and is required to have a minimum number and level of certified staff. The City exceeds these requirements, with some staff certified as Level III and Level IV water distribution operators.

2.0 2023 Event Summary

2.1 Water Main Breaks

The City repaired 3 water main breaks in 2024. The details of these breaks are shown on the table below.

Table #2: Water Main Breaks

Location	Age of Pipe (years)	Pipe Material	Type of Break	Duration of Shutdown (hours)	Number of Services Affected
532 San Remo Drive	1977, 48 years	Ductile Iron Concrete Lined	Hole / Corrosion	~30 hours	3 – temp. connections set up
2400 Clarke St	1962, 53 years	Cast Iron	Hole / Corrosion	~25 hours	1 – temp. connection set up
600 Ioco	1968	Cast Iron	Circumferential	4 hours	23

The City strives to make repairs immediately and to be on-site within one half hour on weekdays from 07:00 to 15:30 and within one hour on weekends, holidays, and weekdays from 15:30 to 07:00.

After repairs are completed, the water main is disinfected per the American Water Works Association C651-14 AWWA Standard for Disinfecting Water Mains (AWWA, 2015). Following completion of these procedures, the water main is flushed until field water quality parameters match background values.

2.2 Metro Vancouver Drinking Water Conservation Plan Summer Support Program

The City participated in this Metro Vancouver pilot program to provide enhanced monitoring and public education related to water conservation. This program was developed as part of the region's Drinking Water Conservation Plan. Metro Vancouver staff conducted patrols of select City areas of the City where non-compliant water use impacts the operation of the City's water distribution system.

Metro Vancouver staff distributed jointly branded Metro Vancouver and City of Port Moody educational materials to properties that were observed to be non-compliant with water use restrictions and provided the results of their monitoring to City staff for the purpose of bylaw enforcement.

Between July 1 and August 31, the Drinking Water Conservation Plan Summer Support Program observed 51 violations of non-compliant water use.

2.3 Regional Stage 1 Water Restrictions

- The Lower Mainland saw several stretches of hot, dry weather in the mid-late summer of 2024. Metro Vancouver implemented Stage 1 water restrictions on DATE. These restrictions meant that: All lawn watering was prohibited
- Trees, shrubs, and flowers could be watered by hand or using soaker hoses or drip irrigation at any time, or by a sprinkler between 5:00 and 9:00 am any day
- Vegetable gardens could be watered at any time

2.4 Variance from Drinking Water Sample Collection Fee for Service Agreement

The City's fee for service agreement with Metro Vancouver to provide drinking water sampling collection and analysis specifies that 48 drinking water samples are to be collected each month. This exceeds the requirement for 37 samples per month in the BCDWPR. Table #3 shows the actual number of samples collected in the City's water distribution system along with the number of samples required by the BCDWPR and the City's fee for service agreement with Metro Vancouver.

Table #3: Number of Samples Collected by Month

Month	Number of Samples Collected	Number of Samples Required by BCDWPR	Number of Samples Required by Fee for Service Agreement
January	63	37	48
February	52	37	48
March	64	37	48
April	68	37	48
May	69	37	48
June	64	37	48
July	59	37	48
August	52	37	48
September	52	37	48
October	63	37	48
November	50	37	48
December	49	37	48
Total	705	433	572

The overall number of samples taken in 2024 exceeded the requirements of the BCDWPR.

2.5 Water Quality Customer Service

Operations Customer Service, which is available by phone 24 hours a day, 7 days a week, received a total of 8 calls related to water quality in 2024. These calls associated with temporary aesthetic impacts to water quality as a result of our water main flushing program. Customers were advised to run a cold water tap until the impacts lessened.

3.0 Water Main Flushing Program

The City of Port Moody conducts uni-directional flushing to maintain a high level of water quality in the distribution system. Uni-directional flushing involves strategically closing valves and opening fire hydrants in sections of the distribution system in order to achieve high water velocities in select water mains. This produces a scouring action that is more effective at cleaning the interior pipe wall than regular flushing and consumes less water. In 2024, the City completed uni-directional flushing on 56.5 kilometres of water main, or about one-third of the City's total water distribution system.

4.0 Water Quality Sampling and Testing

Generally, Metro Vancouver's source water quality met or exceeded standards set by the Guidelines for Canadian Drinking Water Quality (GCDWQ) as well as the BCDWPA and BCDWPR for bacteriological, physical, and chemical water quality.

Sampling and analysis for water quality parameters in Port Moody are conducted on a regular basis by Metro Vancouver staff on behalf of the City. This monitoring is conducted for bacterial, chemical, and physical characteristics.

The BCDWPR requires one monthly sample per 1,000 population. The City's 2024 population was approximately 34,000, meaning that at least 34 monthly samples were required to be taken. Port Moody exceeded the requirements for sampling, with no fewer than 48 were taken in any given month. A total of 692 samples were collected from the City's distribution system in 2024. Appendix #2 shows the location of sampling stations.

4.1 Chemical and Physical Quality

Water quality sampling for chemical and physical parameters, including disinfection by-products, vinyl chloride, and metals, is carried out on varying schedules. Table #4 outlines the frequency with which these qualities are sampled and analyzed.

Table #4: Chemical and Physical Monitoring Frequency

Parameter	Sampling Source	Frequency
Free chlorine residual	Municipal distribution system	Collected with bacteriological samples
Metals(including copper, iron, lead, and zinc)	Municipal distribution system	Semi-annually
Disinfection by-products(including haloacetic acids and trihalomethanes)	Municipal distribution system	Quarterly
pH	Municipal distribution system	Quarterly
Temperature	Municipal distribution system	Quarterly
Turbidity	Municipal distribution system	Collected with bacteriological samples
Vinyl chloride	Municipal distribution system locations where PVC is used	Semi-annually

4.1.1 Metals

Metals can enter drinking water from the source watershed or the distribution system itself. The City of Port Moody's drinking water has historically contained very low concentrations of metal compounds. A complete record of 2024 metals sampling results can be found in Appendix #3.

4.1.2 Disinfection By-Products

Disinfection by-product (DBP) formation occurs when chlorine reacts with dissolved organic compounds present in drinking water. These reactions produce two main groups of DBPs, trihalomethanes (THM) and halo acetic acids (HAA). A complete record of 2024 DBP sampling results can be found in Appendix #4.

4.1.3 Vinyl Chloride

Approximately 660 metres of water main, located near Klahanie Drive, is constructed of polyvinyl chloride (PVC) pipe. Studies have shown that under extreme conditions, it is possible for PVC pipes to allow vinyl chlorides to migrate into drinking water. The Guidelines for Canadian Drinking Water Quality (GCDWQ) set a MAC for vinyl chloride at 2 µg/l (Health Canada, 2017). The City takes samples from these water mains and submits them to Metro Vancouver's laboratory for analysis on a semi-annual basis. All vinyl chloride monitoring results obtained in 2024 were below MAC values. A complete record of 2024 Vinyl Chloride sampling results can be found in Appendix #5.

4.2 Bacteriological Quality

All bacteriological samples collected from the City's water distribution system are analyzed for three key indicators:

- total coliform,
- E. coli bacteria; and
- Heterotrophic plate count (HPC) bacteria.

Total coliform and E. coli analysis indicates whether adequate disinfection is present in the water distribution system. HPC analysis indicates the potential for further bacterial growth within drinking water but does not indicate a direct drinking water safety issue.

The quantity of bacterial samples collected from municipal water distribution systems is based on the population served. Figures #1 and #2 display the number of bacteriological samples collected from the City's water distribution system and the percentage of samples collected that returned HPC results greater than 500 CFU/100 mL each month. Figure #3 demonstrates City compliance with the BCDWPR total coliform bacteria requirements (Health Canada, 2017; Province of British Columbia, 2011).

The presence of total coliform bacteria was detected at sample station PMY-510 on July 5th, August 9th, and September 19th. In response, the City conducted flushing in the nearby water distribution system and cleaned and disinfected the sample station. No further total coliform bacteria were detected at this sample station.

A complete record of 2024 bacteriological water quality sampling results can be found in Appendix #1.

2024 Annual Water Quality Report

Figure#1: Number of Bacterial Samples Analyzed per Month

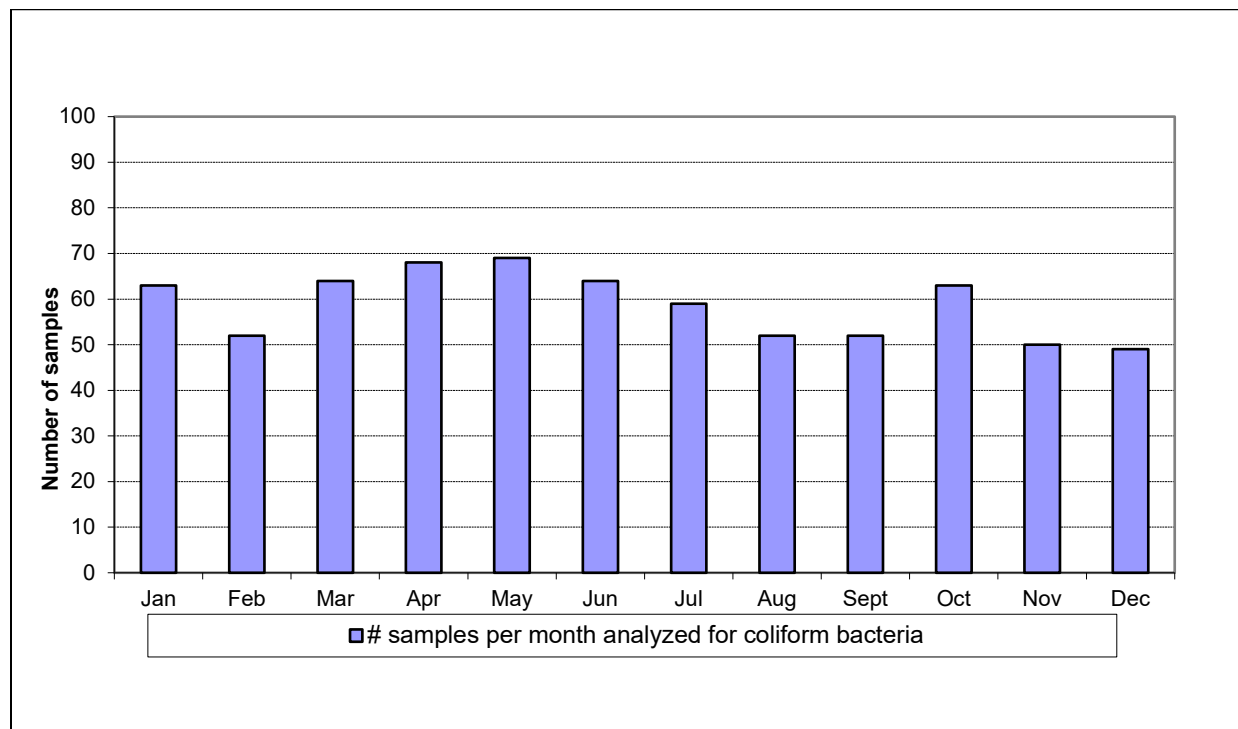


Figure #2: 2024 Monthly Heterotrophic Plate Count Results >500 CFU/mls


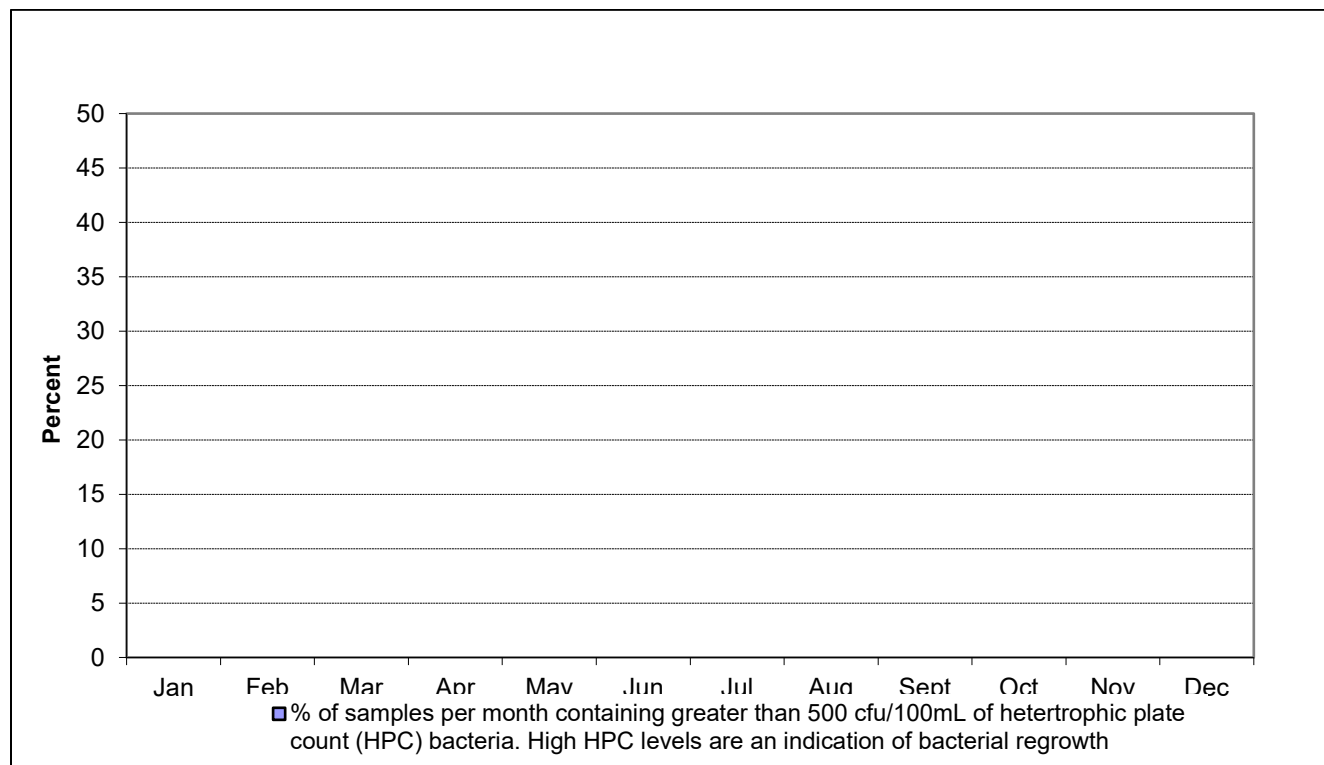


Figure #3: Results of Bacteriological Analysis of Potable Water Samples and Compliance with BCDWPR

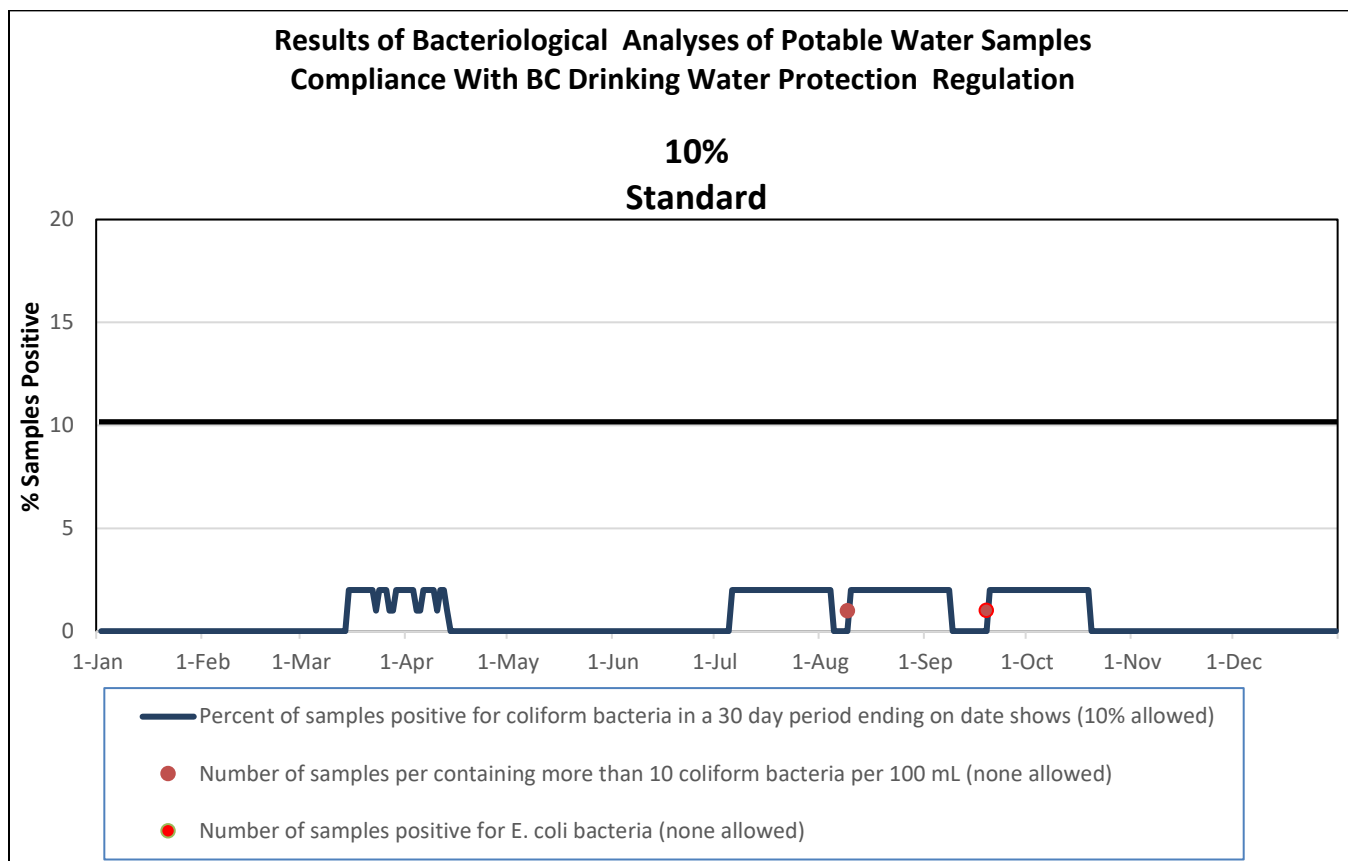

4.3 Chlorine Residual

The water supplied to the City by Metro Vancouver is chlorinated at Metro Vancouver's water treatment facilities, and again throughout their transmission system. The City re-chlorinates water at Ioco Road Rechlorination Station and at Chestnut Way Rechlorination Station to provide for disinfection and bacterial regrowth prevention in extended areas of the City's water distribution system. These facilities provide this necessary function in the April Road, Pleasantville, Ioco, Twin Creeks, Heritage Mountain, and Heritage Woods neighbourhoods.

Maintaining adequate chlorine residual in a potable water distribution system is vital to preserving public health. The City strives to achieve a balance of aesthetics and disinfection when maintaining chlorine residuals.

5.0 Water Distribution System Projects

A pilot project intended to identify potential challenges with universal water metering was implemented in 2024. Port Moody wishes to evaluate the expansion of water metering to include all customers in alignment with the recommendations of the Residential Water Metering Guide (Metro Vancouver, 2019) and the goals of the City's Climate Action Plan to support sustainability, water conservation and improved billing equity.

Early design and planning for new PRV's to sustain the creation of new pressure zones in the College Park and Seaview neighbourhoods was completed in 2024. The design process was also initiated for the capital replacement of the Guildford Drive PRV and Dewdney Trunk Road PRV, both of which are nearing the end of their life cycles.

6.0 Conclusion

In 2024, drinking water in the City of Port Moody met or exceeded the requirements of both the Guidelines for Canadian Drinking Water Quality and the British Columbia Drinking Water Act and Regulation. The City works closely with stakeholders, including Fraser Health and Metro Vancouver, in the operation of the City's water distribution system. Port Moody Operations staff work to ensure safe, clean, reliable, drinking water is delivered to the City's residents at a reasonable cost.

References

American Water Works Association. (2015). *ANSI/AWWA C651-14 – AWWA Standard for Disinfecting Water Mains*.

Drinking Water Protection Regulation, BC Reg 47/2024

Health Canada. (2009). *Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Chlorine*. Ottawa: Health Canada.

Health Canada. (2013). *Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Heterotrophic Plate Counts*. Ottawa: Health Canada.

Metro Vancouver. (2011). *Metro Vancouver Drinking Water Management Plan*.
<http://www.metrovancouver.org/services/water/WaterPublications/DWMP-2011.pdf>

Metro Vancouver. (2019). *Residential Water Metering in Metro Vancouver, Best Practices Guide for Local Governments*. [Residential Water Metering in Metro Vancouver: Best Practices Guide for Local Governments](#)

City of Port Moody. (2020). *Climate Action Plan*. [Port Moody Climate Action Plan July 2020](#)

Appendix #1

Bacterial Analysis

PMY 506 – 22 Crawford Bay

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-11 09:56	0	<1	<2	9	<1	0.33
2024-01-23 10:59	0.1	<1	<2	6.8	<1	0.39
2024-01-29 10:59	0.16	<1	12	7	<1	0.74
2024-01-30 10:57	0.12	<1	2	7.4	<1	0.62
2024-02-01 11:32	0.11	<1	2	7.5	<1	0.32
2024-02-07 10:13	0.09	<1	2	8.1	<1	0.34
2024-02-15 10:59	0.03	<1	<2	7.1	<1	0.36
2024-02-22 13:05	0.11	<1	68	7.8	<1	0.6
2024-03-01 09:36	0.06	<1	2	7.9	<1	0.32
2024-03-07 11:56	0.08	<1	<2	7.5	<1	0.32
2024-03-12 10:25	0.14	<1	<2	7.8	<1	0.36
2024-03-14 11:04	0.07	<1	4	7.3	<1	0.31
2024-03-21 12:14	0.17	<1	2	8.5	<1	0.3
2024-03-26 09:37	0.03	<1	2	8.7	<1	0.29
2024-04-03 11:25	0.22	<1	16	9.1	<1	0.35
2024-04-09 09:25	0.09	<1	<2	9.6	<1	0.49
2024-04-16 09:24	0.07	<1	2	10	<1	0.26
2024-04-22 09:09	0.08	<1	20	10.1	<1	0.4
2024-05-08 09:03	0.08	<1	<2	13.7	<1	0.24
2024-05-14 11:03	0.22	<1	8	13.8	<1	0.2
2024-05-23 11:35	0.09	<1	44	11.9	<1	0.28
2024-05-28 11:30	0.14	<1	28	12.3	<1	0.27
2024-06-05 09:13	0.01	<1	84	13.3	<1	0.44
2024-06-06 09:09	0.06	<1	68	13.8	<1	0.29
2024-06-12 08:59	0.07	<1	98	14.1	<1	0.61
2024-06-20 09:05	0.09	<1	28	14.9	<1	0.25
2024-06-24 12:37	0.15	<1	130	15.3	<1	0.32
2024-07-04 12:40	0.11	<1	52	15.9	<1	0.17
2024-07-11 12:00	0.1	<1	2	16.5	<1	0.22
2024-07-18 11:55	0.14	<1	10	17.2	<1	0.16
2024-07-22 11:54	0.2	<1	<2	17.2	<1	0.27
2024-07-31 08:46	0.06	<1	70	17.3	<1	0.37
2024-08-09 10:26	0.18	<1	78	17.8	<1	0.39
2024-08-13 13:03	0.22	<1	2	17.2	<1	0.17
2024-08-21 09:06	0.09	<1	32	18.1	<1	0.36
2024-08-28 09:07	0.08	<1	52	17.4	<1	0.42
2024-09-05 09:07	0.06	<1	2	17.9	<1	0.17
2024-09-11 11:15	0.18	<1	110	17.2	<1	0.27
2024-09-19 09:06	0.1	<1	40	17.6	<1	0.24
2024-09-23 11:56	0.17	<1	2	16.7	<1	0.31

2024 Annual Water Quality Report

2024-09-25 09:48	0.02	<1	50	17	<1	0.31
2024-10-03 13:06	0.16	<1	28	17.1	<1	0.2
2024-10-10 09:22	0.06	<1	10	16.1	<1	0.19
2024-10-17 09:23	0.34	<1	20	15.3	<1	0.19
2024-10-24 10:47	0.05	<1	12	12.5	<1	1.8
2024-10-31 11:39	0.13	<1	24	14	<1	0.81
2024-11-03 10:11	0.13	<1	30	13.5	<1	0.62
2024-11-15 11:48	0	<1	22	12.9	<1	0.34
2024-11-23 09:51	0.18	<1	16	11.7	<1	0.38
2024-11-28 10:01	0.07	<1	26	11.2	<1	0.37
2024-12-05 11:06	0.13	<1	26	9.5	<1	0.32
2024-12-11 11:00	0.1	<1	18	8.4	<1	0.54
2024-12-20 09:15	0.13	<1	NA	9.1	<1	0.61

PMY 507 – 206 Edward Crescent

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 09:14	0.42	<1	<2	8.8	<1	0.53
2024-01-12 10:15	0.44	<1	<2	6.5	<1	0.62
2024-01-22 08:14	0.51	<1	<2	5.9	<1	0.45
2024-01-23 12:51	0.38	<1	2	5.9	<1	0.46
2024-01-29 09:10	0.5	<1	<2	6.1	<1	0.78
2024-01-30 11:57	0.43	<1	<2	6.3	<1	0.57
2024-02-07 08:45	0.29	<1	<2	6.8	<1	0.47
2024-02-12 09:25	0.33	<1	<2	6.8	<1	0.49
2024-02-15 12:35	0.36	<1	4	7.5	<1	0.43
2024-02-22 13:39	0.36	<1	2	7.5	<1	0.3
2024-02-27 07:15	0.35	<1	2	7.1	<1	0.36
2024-03-07 12:51	0.46	<1	<2	6	<1	0.39
2024-03-12 07:55	0.38	<1	<2	6.4	<1	0.34
2024-03-14 13:26	0.37	<1	<2	6.1	<1	0.3
2024-03-21 09:03	0.45	<1	<2	7.2	<1	0.35
2024-03-26 08:27	0.34	<1	<2	7	<1	0.29
2024-04-03 09:18	0.27	<1	<2	7.7	<1	0.35
2024-04-09 08:20	0.39	<1	<2	7.8	<1	0.28
2024-04-12 12:44	0.47	<1	2	7.8	<1	0.26
2024-04-16 08:17	0.37	<1	4	7.7	<1	0.25
2024-04-19 10:10	0.34	<1	<2	8	<1	0.22
2024-04-22 13:08	0.42	<1	<2	8	<1	0.23
2024-04-25 12:47	0.43	<1	8	10.1	<1	0.17
2024-05-02 11:35	0.33	<1	<2	12	<1	0.25
2024-05-03 12:20	0.4	<1	<2	8.7	<1	0.29
2024-05-08 11:53	0.23	<1	6	9.8	<1	0.15
2024-05-14 08:53	0.36	<1	<2	10.9	<1	0.26
2024-05-16 10:10	0.4	<1	<2	11.4	<1	0.26
2024-05-17 10:57	0.35	<1	<2	10.2	<1	0.3
2024-05-23 08:56	0.27	<1	<2	10.2	<1	0.31

2024 Annual Water Quality Report

2024-05-28 09:04	0.22	<1	<2	12.2	<1	0.27
2024-06-05 08:07	0.16	<1	<2	11.5	<1	0.26
2024-06-06 08:28	0.35	<1	2	10.6	<1	0.3
2024-06-12 08:25	0.3	<1	<2	11.5	<1	0.28
2024-06-20 08:22	0.33	<1	<2	11.7	<1	0.25
2024-06-24 07:56	0.3	<1	<2	11.7	<1	0.22
2024-06-25 08:47	0.3	<1	2	12	<1	0.3
2024-07-04 11:55	0.36	<1	<2	15	<1	0.22
2024-07-11 09:56	0.14	<1	<2	13.2	<1	0.33
2024-07-18 09:34	0.44	<1	<2	15	<1	0.24
2024-07-22 09:08	0.35	<1	<2	13.5	<1	0.21
2024-08-09 12:05	0.29	<1	110	15.5	<1	3.3
2024-08-13 10:39	0.28	<1	4	14.7	<1	0.18
2024-08-15 07:09	0.37	<1	<2	14.7	<1	0.17
2024-08-16 12:27	0.37	<1	<2	14.7	<1	0.23
2024-08-21 08:03	0.19	<1	<2	14.8	<1	0.24
2024-08-28 08:22	0.26	<1	<2	14.5	<1	0.2
2024-09-05 08:31	0.39	<1	2	15.9	<1	0.22
2024-09-11 09:10	0.33	<1	<2	15	<1	0.17
2024-09-19 07:33	0.26	<1	<2	14.7	<1	0.23
2024-09-23 09:24	0.22	<1	2	15	<1	0.19
2024-09-25 10:30	0.19	<1	<2	15	<1	0.2
2024-10-03 11:14	0.22	<1	6	15	<1	0.19
2024-10-10 08:13	0.2	<1	2	13.9	<1	0.2
2024-10-17 08:38	0.15	<1	2	13	<1	0.2
2024-10-24 10:07	0.37	<1	<2	12.5	<1	2.1
2024-10-31 12:49	0.3	<1	2	12.1	<1	1.1
2024-11-03 09:33	0.27	<1	<2	11.9	<1	0.95
2024-11-13 12:10	0.38	<1	<2	11	<1	0.71
2024-11-23 07:01	0.41	<1	2	9.7	<1	0.38
2024-11-27 07:12	0.2	<1	<2	9.6	<1	0.4
2024-11-28 08:49	0.24	<1	<2	9.2	<1	0.38
2024-11-29 12:20	0.25	<1	<2	9	<1	0.55
2024-12-05 08:56	0.22	<1	2	7.7	<1	0.61
2024-12-11 08:53	0.2	<1	<2	7.9	<1	0.35
2024-12-20 07:51	0.17	<1	NA	8.4	<1	0.66
2024-12-24 11:37	0.36	<1	NA	8.4	<1	0.38
2024-12-27 08:45	0.39	<1	NA	8.1	<1	0.34

PMY 508 – 518 Ailsa Avenue

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 12:26	0.43	<1	2	9.1	<1	0.17
2024-01-10 13:24	0.4	<1	<2	8.8	<1	0.2
2024-01-11 07:16	0.36	<1	<2	8.6	<1	0.12
2024-01-12 12:40	0.43	<1	<2	7.1	<1	0.25
2024-01-17 07:36	0.17	<1	<2	7.3	<1	0.11
2024-01-19 12:53	0.52	<1	<2	6.1	<1	0.18
2024-01-23 14:02	0.54	<1	<2	8.2	<1	0.13
2024-01-25 11:46	0.51	<1	<2	6.3	<1	0.13
2024-01-29 11:28	0.35	<1	<2	6	<1	0.19
2024-01-30 07:35	0.48	<1	2	7.3	<1	0.31
2024-02-02 11:53	0.38	<1	<2	8.1	<1	0.2
2024-02-07 07:06	0.48	<1	<2	8.3	<1	0.2
2024-02-12 11:09	0.41	<1	2	8.2	<1	0.19
2024-02-15 08:49	0.42	<1	<2	5.5	<1	0.61
2024-02-22 07:24	0.76	<1	<2	5.9	<1	0.24
2024-02-23 13:41	0.57	<1	2	6.8	<1	0.32
2024-02-27 10:12	0.67	<1	4	6.1	<1	0.14
2024-03-06 13:54	0.58	<1	2	5.1	<1	0.17
2024-03-11 12:45	0.42	<1	<2	7.3	<1	0.16
2024-03-14 14:06	0.45	<1	<2	7.2	<1	0.12
2024-03-22 11:13	0.49	<1	<2	8.6	<1	0.28
2024-03-26 07:05	0.54	<1	<2	8.9	<1	0.17
2024-04-03 12:49	0.66	<1	<2	8.8	<1	0.2
2024-04-09 06:56	0.48	<1	<2	10.1	<1	0.19
2024-04-12 13:59	0.54	<1	2	10.1	<1	0.22
2024-04-16 06:57	0.48	<1	<2	10.6	<1	0.14
2024-04-19 11:31	0.51	<1	<2	11.1	<1	0.17
2024-04-22 13:43	0.49	<1	<2	11.2	<1	0.17
2024-04-25 13:46	0.37	<1	2	11.2	<1	0.15
2024-04-30 14:04	0.38	<1	4	12.3	<1	0.11
2024-05-03 11:17	0.22	<1	<2	12.2	<1	0.18
2024-05-08 13:02	0.2	<1	<2	13	<1	0.15
2024-05-10 13:11	0.34	<1	2	12.4	<1	0.26
2024-05-14 12:45	0.59	<1	2	12.4	<1	0.16
2024-05-16 11:47	0.31	<1	<2	11.6	<1	0.3
2024-05-17 08:08	0.71	<1	2	13.7	<1	0.2
2024-05-23 12:57	0.37	<1	4	14.2	<1	0.15
2024-05-28 13:08	0.52	<1	24	13.3	<1	1
2024-06-05 06:57	0.25	<1	4	14.3	<1	0.13
2024-06-06 07:15	0.33	<1	<2	14.3	<1	0.11
2024-06-12 07:03	0.16	<1	4	15.6	<1	0.2
2024-06-13 09:35	0.15	<1	14	12.5	<1	0.2
2024-06-20 07:07	0.49	<1	<2	12.1	<1	0.19
2024-06-25 12:23	0.83	<1	2	14.9	<1	0.25

2024 Annual Water Quality Report

2024-07-05 10:59	0.19	<1	22	15.9	<1	0.16
2024-07-11 07:29	0.49	<1	<2	18.3	<1	0.18
2024-07-19 11:26	0.08	<1	26	19.3	<1	1.2
2024-07-25 11:10	0.21	<1	10	15	<1	0.11
2024-08-09 11:44	0.21	<1	22	16.9	<1	0.14
2024-08-15 07:52	0.2	<1	18	19.9	<1	0.11
2024-08-21 06:57	0.09	<1	18	19.8	<1	0.12
2024-08-28 07:06	0.13	<1	22	18.7	<1	0.17
2024-09-05 07:11	0.1	<1	22	19.3	<1	0.14
2024-09-11 12:41	0.27	<1	<2	18	<1	0.14
2024-09-19 10:13	0.37	<1	22	18.5	<1	0.13
2024-09-27 07:28	0.04	<1	<2	18.1	<1	0.15
2024-10-04 10:32	0.15	<1	6	16	<1	0.34
2024-10-10 07:00	0.16	<1	12	16.6	<1	0.17
2024-10-17 07:17	0.15	<1	6	15.8	<1	0.18
2024-10-24 08:47	0.18	<1	6	14.5	<1	0.15
2024-11-03 07:46	0.17	<1	36	13.5	<1	0.19
2024-11-13 11:40	0.15	<1	4	10.7	<1	0.16
2024-11-20 13:46	0.3	<1	12	11.1	<1	0.19
2024-11-23 10:39	0.16	<1	4	11.9	<1	0.13
2024-11-28 07:16	0.86	<1	<2	10.5	<1	0.13
2024-11-29 13:18	0.21	<1	18	8.9	<1	0.14
2024-12-04 13:50	0.3	<1	<2	8.8	<1	0.15
2024-12-11 11:51	0.18	<1	2	9.1	<1	0.19
2024-12-20 10:25	0.24	<1	NA	8.8	<1	0.19
2024-12-30 07:10	0.88	<1	NA	7	<1	0.11

PMY 509 – 1240 Alderside Road

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 10:56	0.22	<1	2	8.4	<1	0.49
2024-01-11 09:48	0.15	<1	<2	8.4	<1	0.48
2024-01-12 11:09	0.33	<1	<2	6.7	<1	0.48
2024-01-19 11:25	0.64	<1	<2	6.8	<1	0.49
2024-01-23 10:48	0.3	<1	2	8.6	<1	0.45
2024-01-25 11:00	0.56	<1	<2	6	<1	0.75
2024-01-29 10:40	0.31	<1	<2	7	<1	1.2
2024-02-01 11:27	0.16	<1	<2	7.3	<1	0.36
2024-02-07 10:29	0.23	<1	<2	7.3	<1	0.69
2024-02-15 10:49	0.31	<1	<2	6.9	<1	0.36
2024-02-22 12:57	0.33	<1	<2	7.8	<1	0.33
2024-02-27 09:46	0.38	<1	<2	8.1	<1	0.35
2024-03-07 12:02	0.41	<1	<2	7.2	<1	0.29
2024-03-12 10:06	0.44	<1	<2	7.5	<1	0.32
2024-03-14 10:52	0.23	<1	<2	7.4	<1	0.26
2024-03-16 11:44	0.47	<1	<2	6.8	<1	0.68
2024-03-21 11:51	0.31	<1	<2	7.6	<1	0.26
2024-03-22 10:27	0.52	<1	<2	9.1	<1	0.5
2024-03-26 09:42	0.25	<1	<2	9.3	<1	0.31
2024-04-03 11:18	0.23	<1	<2	8.9	<1	0.39
2024-04-09 09:29	0.17	<1	<2	10.1	<1	0.27
2024-04-12 10:24	0.33	<1	<2	8.6	<1	0.41
2024-04-16 09:30	0.15	<1	<2	10.9	<1	0.23
2024-04-19 09:50	0.32	<1	2	10.6	<1	0.5
2024-04-22 08:51	0.28	<1	<2	10.8	<1	0.63
2024-05-02 12:32	0.24	<1	<2	11.7	<1	0.21
2024-05-03 10:07	0.23	<1	<2	11.8	<1	0.48
2024-05-08 08:49	0.25	<1	<2	10.8	<1	0.48
2024-05-14 10:52	0.27	<1	<2	13.4	<1	0.22
2024-05-16 09:18	0.19	<1	<2	11.9	<1	0.24
2024-05-23 11:16	0.17	<1	2	10.9	<1	0.31
2024-05-28 11:11	0.15	<1	2	14	<1	0.32
2024-06-05 09:18	0.17	<1	<2	13.5	<1	0.43
2024-06-06 09:16	0.14	<1	2	14	<1	0.22
2024-06-12 09:06	0.19	<1	<2	14.8	<1	0.52
2024-06-20 09:16	0.18	<1	<2	14.9	<1	0.2
2024-06-24 12:14	0.2	<1	<2	12.9	<1	0.3
2024-06-25 10:59	0.19	<1	<2	15.2	<1	0.22
2024-07-04 12:28	0.18	<1	<2	14.9	<1	0.2
2024-07-10 12:21	0.52	<1	<2	16.2	<1	0.37
2024-07-11 12:11	0.41	<1	<2	16.5	<1	0.26
2024-07-18 11:46	0.53	<1	<2	17.3	<1	0.21
2024-07-22 11:37	1.03	<1	<2	16.3	<1	0.41
2024-07-31 08:51	0.66	<1	2	17.5	<1	0.44

2024 Annual Water Quality Report

2024-08-09 10:19	0.74	<1	<2	16.8	<1	0.31
2024-08-13 12:43	0.45	<1	<2	14.9	<1	0.14
2024-08-15 12:13	0.64	<1	2	18	<1	0.14
2024-08-21 09:11	0.45	<1	<2	18	<1	0.18
2024-08-28 08:59	0.34	<1	4	17	<1	0.35
2024-09-05 09:14	0.12	<1	66	17.6	<1	1.1
2024-09-11 10:58	0.6	<1	<2	15.9	<1	0.27
2024-09-19 08:54	0.19	<1	2	16	<1	0.17
2024-09-23 11:39	0.43	<1	<2	16.3	<1	0.21
2024-09-25 10:06	0.17	<1	6	17	<1	0.31
2024-10-04 09:39	0.55	<1	<2	15.2	<1	0.45
2024-10-10 09:29	0.36	<1	<2	15.9	<1	0.16
2024-10-17 09:32	0.05	<1	<2	15.1	<1	0.17
2024-10-22 11:08	0.19	<1	2	14.2	<1	2.1
2024-10-24 10:56	0.12	<1	<2	13.6	<1	1.8
2024-10-31 10:30	0.16	<1	<2	11.7	<1	0.87
2024-11-03 10:20	0.18	<1	<2	13	<1	0.8
2024-11-15 12:09	0.14	<1	2	12.1	<1	0.85
2024-11-23 09:35	0.17	<1	2	9.6	<1	0.36
2024-11-28 10:14	0.08	<1	<2	10.2	<1	0.35
2024-12-05 10:50	0.17	<1	<2	9	<1	0.34
2024-12-11 10:44	0.19	<1	<2	9.1	<1	0.83
2024-12-20 09:03	0.23	<1	NA	8.7	<1	1.2
2024-12-24 12:46	0.16	<1	NA	8.5	<1	0.35
2024-12-27 08:59	0.27	<1	NA	8.8	<1	0.63

PMY 510 – 2000 Panorama Drive

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 09:50	0.68	<1	<2	7.7	<1	0.52
2024-01-11 11:05	1.01	<1	2	6.7	<1	0.68
2024-01-23 12:27	0.88	<1	4	6.9	<1	0.57
2024-01-29 10:09	0.52	<1	<2	6.2	<1	0.95
2024-01-30 08:57	1.02	<1	8	7.2	<1	0.77
2024-02-01 12:37	0.64	<1	<2	6.3	<1	0.51
2024-02-07 11:09	0.34	<1	2	6.7	<1	0.49
2024-02-15 12:20	0.33	<1	<2	6.1	<1	0.54
2024-02-22 11:57	0.33	<1	<2	7.1	<1	0.37
2024-03-01 10:14	0.6	<1	10	6	<1	0.43
2024-03-07 10:16	0.25	<1	2	5.6	<1	0.43
2024-03-14 11:56	0.22	<1	<2	6.2	<1	0.32
2024-03-21 10:33	0.49	<1	<2	6.8	<1	0.39
2024-03-26 10:10	0.64	<1	<2	6.2	<1	0.33
2024-04-03 10:18	0.42	<1	<2	6.6	<1	0.57
2024-04-09 09:54	0.67	<1	<2	6.6	<1	0.36
2024-04-12 11:35	0.94	<1	<2	7	<1	0.28
2024-04-16 09:58	0.7	<1	<2	6.6	<1	0.29
2024-04-22 10:37	0.42	<1	6	7.8	<1	0.33
2024-05-03 09:44	0.28	<1	2	8.8	<1	0.29
2024-05-08 09:57	0.24	<1	86	8.8	<1	0.35
2024-05-14 10:04	0.81	<1	4	11	<1	0.43
2024-05-23 10:21	0.28	<1	<2	11.1	<1	0.33
2024-05-28 10:08	0.22	<1	2	10.5	<1	0.29
2024-06-05 09:45	0.85	<1	2	8.5	<1	0.4
2024-06-06 09:41	0.3	<1	<2	10.3	<1	0.22
2024-06-12 09:39	0.83	<1	<2	8.7	<1	0.47
2024-06-20 09:41	0.68	<1	2	10.5	<1	0.21
2024-06-25 09:54	0.65	<1	<2	10.5	<1	0.33
2024-07-05 09:31	0.92	<1	46	11	5*	0.31
2024-07-11 10:51	0.03	<1	<2	17	<1	0.27
2024-07-12 08:44	0.57	<1	50	11.8	<1	0.3
2024-07-18 10:46	0.71	<1	2	12.8	<1	0.3
2024-07-22 10:40	0.64	<1	<2	13.6	<1	0.24
2024-07-31 09:18	0.77	<1	<2	12.2	<1	0.22
2024-08-09 09:27	0.86	<1	78	13	43*	0.24
2024-08-13 11:34	0.34	<1	<2	14.1	<1	0.17
2024-08-21 09:36	0.75	<1	<2	13.8	<1	0.22
2024-08-28 09:31	1.01	<1	16	13.4	<1	0.32
2024-09-05 10:06	0.62	<1	<2	14	<1	0.33
2024-09-11 10:16	0.83	<1	<2	15.2	<1	0.3
2024-09-19 08:07	0.93	<1	18	14.5	11*	0.49
2024-09-25 09:13	0.14	<1	4	15.1	<1	0.25
2024-10-03 12:00	0.99	<1	<2	14.1	<1	0.22

2024 Annual Water Quality Report

2024-10-10 09:56	0.26	<1	4	14	<1	0.22
2024-10-17 10:04	0.91	<1	10	12.4	<1	0.27
2024-10-21 11:25	1.07	<1	<2	12	<1	5.2
2024-10-22 10:34	1.34	<1	<2	11.9	<1	5.1
2024-10-23 08:02	1.13	<1	<2	11	<1	4.8
2024-10-24 11:33	0.86	<1	<2	11.1	<1	3.2
2024-10-30 11:25	0.61	<1	28	11.4	<1	1.3
2024-11-03 10:58	0.51	<1	18	11.9	<1	0.88
2024-11-15 09:22	0.97	<1	<2	10.5	<1	0.92
2024-11-23 08:45	1.01	<1	<2	9.3	<1	0.44
2024-11-28 11:03	0.94	<1	<2	9.5	<1	0.54
2024-12-05 09:57	0.85	<1	4	8.2	<1	0.44
2024-12-11 09:52	0.62	<1	2	7.9	<1	0.48
2024-12-20 08:18	0.92	<1	NA	7.7	<1	0.9
2024-12-24 11:53	0.61	<1	NA	7.9	<1	0.49

PMY 511 – 2701 Clarke Street

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 11:38	0.42	<1	<2	8.4	<1	0.45
2024-01-11 08:26	0.43	<1	<2	7.6	<1	0.38
2024-01-17 12:59	0.55	<1	<2	6	<1	0.44
2024-01-23 13:37	0.47	<1	<2	5.7	<1	0.49
2024-01-30 12:19	0.58	<1	<2	6.3	<1	0.58
2024-02-07 07:59	0.3	<1	<2	7.3	<1	0.51
2024-02-15 09:13	0.35	<1	<2	5.8	<1	0.45
2024-02-22 08:28	0.44	<1	<2	6.7	<1	0.35
2024-03-01 08:32	0.4	<1	28	6.7	<1	0.35
2024-03-07 13:44	0.6	<1	<2	6.3	<1	0.47
2024-03-14 13:34	0.48	<1	<2	6.3	<1	0.43
2024-03-22 10:50	0.3	<1	<2	7.5	<1	0.43
2024-03-26 07:42	0.21	<1	<2	7.5	<1	0.36
2024-04-03 11:55	0.36	<1	4	7.7	<1	0.27
2024-04-09 07:38	0.37	<1	<2	8.2	<1	0.27
2024-04-12 13:27	0.53	<1	<2	8.1	<1	0.34
2024-04-16 07:37	0.39	<1	<2	8.1	<1	0.23
2024-04-19 10:50	0.44	<1	4	8.6	<1	0.28
2024-04-25 12:57	0.18	<1	<2	10.1	<1	0.29
2024-05-03 10:51	0.55	<1	<2	9.9	<1	0.3
2024-05-08 12:33	0.17	<1	<2	11.7	<1	0.48
2024-05-17 09:03	0.34	<1	<2	10.4	<1	0.31
2024-05-24 07:39	0.26	<1	<2	10.5	<1	0.29
2024-05-28 12:52	0.36	<1	<2	10.7	<1	0.31
2024-06-05 07:30	0.3	<1	<2	11.5	<1	0.27
2024-06-06 07:49	0.37	<1	<2	11	<1	0.24
2024-06-12 07:38	0.34	<1	2	12	<1	0.28

2024 Annual Water Quality Report

2024-06-20 07:44	0.33	<1	<2	12.2	<1	0.2
2024-06-25 11:55	0.5	<1	16	12.1	<1	0.75
2024-07-05 10:36	0.3	<1	<2	13	<1	0.22
2024-07-11 08:12	0.23	<1	<2	13.9	<1	0.19
2024-07-18 13:16	0.24	<1	4	13.8	<1	0.28
2024-07-22 12:33	0.33	<1	<2	14.3	<1	0.27
2024-07-31 07:29	0.21	<1	<2	14.5	<1	0.14
2024-08-09 10:58	0.46	<1	<2	14.4	<1	0.21
2024-08-15 07:31	0.32	<1	<2	15.2	<1	0.15
2024-08-21 07:27	0.21	<1	2	15.1	<1	0.17
2024-08-28 07:44	0.3	<1	2	14.9	<1	0.19
2024-09-05 07:49	0.4	<1	<2	15.2	<1	0.17
2024-09-11 11:51	0.62	<1	<2	14.5	<1	0.18
2024-09-19 09:38	0.27	<1	<2	15.3	<1	0.23
2024-09-23 12:48	0.22	<1	2	15.2	<1	0.23
2024-10-04 10:07	0.37	<1	14	14.5	<1	0.33
2024-10-10 07:30	0.26	<1	4	14.1	<1	0.18
2024-10-17 07:56	0.2	<1	2	13.4	<1	0.2
2024-10-24 09:23	0.69	<1	<2	12.3	<1	2.1
2024-11-03 08:21	0.36	<1	<2	12	<1	0.9
2024-11-14 07:55	0.22	<1	4	11.4	<1	0.64
2024-11-23 10:13	0.17	<1	<2	9.8	<1	0.39
2024-11-28 08:07	0.22	<1	<2	9.7	<1	0.41
2024-12-05 11:26	0.22	<1	<2	8.8	<1	0.53
2024-12-11 11:33	0.39	<1	8	8.5	<1	4.1
2024-12-20 09:41	0.37	<1	NA	8	<1	0.65

PMY 512 – 202 Cecile Drive

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 12:07	0.39	<1	160	8.5	<1	0.18
2024-01-11 07:32	0.52	<1	<2	6.3	<1	0.42
2024-01-17 08:05	0.68	<1	<2	4.5	<1	0.11
2024-01-23 13:53	0.62	<1	2	6.6	<1	0.11
2024-02-01 13:36	0.65	<1	2	7	<1	0.96
2024-02-07 07:19	0.5	<1	<2	6.8	<1	0.12
2024-02-12 11:20	0.39	<1	<2	7.7	<1	0.18
2024-02-15 07:11	0.45	<1	2	5.5	<1	0.57
2024-02-22 07:34	0.69	<1	<2	6.1	<1	0.28
2024-02-23 13:32	0.52	<1	<2	7	<1	0.24
2024-03-01 08:07	0.48	<1	2	5.5	<1	0.2
2024-03-06 14:07	0.63	<1	<2	5.3	<1	0.18
2024-03-14 14:06	0.42	<1	<2	7.5	<1	0.13
2024-03-22 11:26	0.41	<1	<2	8	<1	0.19
2024-03-26 07:16	0.43	<1	<2	7.7	<1	0.14
2024-04-03 12:31	0.38	<1	<2	8.5	<1	0.2
2024-04-09 07:09	0.58	<1	2	8.1	<1	0.35
2024-04-12 13:49	0.47	<1	<2	10.4	<1	0.22

2024 Annual Water Quality Report

2024-04-16 07:10	0.46	<1	<2	8.4	<1	0.16
2024-04-19 11:26	0.47	<1	4	11.9	<1	0.16
2024-04-25 13:22	0.28	<1	<2	12.3	<1	0.16
2024-04-30 13:53	0.36	<1	6	12.7	<1	0.11
2024-05-03 11:32	0.33	<1	<2	11.7	<1	0.38
2024-05-08 12:46	0.17	<1	2	13.8	<1	0.13
2024-05-10 13:24	0.57	<1	<2	11.1	<1	0.21
2024-05-16 12:04	0.43	<1	6	12	<1	0.3
2024-05-17 08:19	0.67	<1	2	12.5	<1	0.32
2024-05-24 07:18	0.58	<1	<2	12	<1	0.13
2024-05-28 13:18	0.29	<1	2	11.1	<1	0.26
2024-06-05 07:04	0.41	<1	<2	12.1	<1	0.11
2024-06-06 07:28	0.48	<1	2	12.2	<1	0.11
2024-06-12 07:14	0.42	<1	4	13.8	<1	0.26
2024-06-20 07:23	0.3	<1	<2	13.6	<1	0.13
2024-06-25 12:38	0.24	<1	70	13	<1	0.31
2024-07-05 11:10	0.39	<1	<2	14	<1	0.21
2024-07-11 07:45	0.3	<1	<2	17	<1	0.17
2024-07-18 13:37	0.29	<1	12	13.9	<1	0.2
2024-07-25 11:34	0.25	<1	10	17.5	<1	0.15
2024-07-31 07:05	0.34	<1	<2	17.5	<1	0.15
2024-08-09 11:23	0.33	<1	8	18.5	<1	0.13
2024-08-15 08:04	0.5	<1	14	18.1	<1	0.12
2024-08-21 07:05	0.39	<1	20	18	<1	0.15
2024-08-28 07:17	0.33	<1	12	16.5	<1	0.13
2024-09-05 07:23	0.35	<1	2	17	<1	0.13
2024-09-11 12:19	0.34	<1	<2	17	<1	0.12
2024-09-19 10:02	0.19	<1	10	16.3	<1	0.15
2024-09-27 07:43	0.26	<1	2	15.9	<1	0.16
2024-10-04 10:35	0.19	<1	8	15.2	<1	0.15
2024-10-10 07:11	0.34	<1	12	14.3	<1	0.2
2024-10-17 07:30	0.44	<1	8	13.2	<1	0.2
2024-10-24 08:59	0.7	<1	<2	11.1	<1	0.16
2024-11-03 07:57	0.38	<1	2	11	<1	0.15
2024-11-13 11:52	0.47	<1	<2	10.8	<1	0.13
2024-11-23 10:51	0.19	<1	<2	10.3	<1	0.11
2024-11-28 07:35	0.48	<1	<2	7.5	<1	0.12
2024-11-29 13:34	0.39	<1	<2	9.6	<1	0.16
2024-12-05 11:43	0.28	<1	<2	8	<1	0.28
2024-12-11 12:07	0.34	<1	<2	8	<1	0.13
2024-12-20 10:10	0.31	<1	NA	8.4	<1	0.15
2024-12-30 07:21	0.56	<1	NA	7.2	<1	0.32

PMY 513 – 485 Guildford Drive

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 11:21	0.88	<1	8	7.4	<1	0.5
2024-01-11 08:41	1.02	<1	<2	8.2	<1	0.39
2024-01-24 07:45	1.27	<1	<2	6.8	<1	1.3
2024-01-30 08:30	0.5	<1	60	7.1	<1	0.54
2024-02-01 10:54	0.75	<1	2	7.1	<1	0.36
2024-02-09 10:43	0.85	<1	<2	8.3	<1	0.76
2024-02-15 10:28	0.55	<1	<2	5.2	<1	0.45
2024-02-22 11:34	0.94	<1	2	8.8	<1	0.46
2024-03-01 11:35	0.77	<1	<2	8.4	<1	0.47
2024-03-07 09:47	0.43	<1	<2	6.6	<1	0.32
2024-03-14 10:08	0.33	<1	<2	7.3	<1	0.31
2024-03-21 12:42	0.55	<1	2	7.4	<1	0.42
2024-03-26 11:01	0.7	<1	<2	10.5	<1	0.39
2024-04-03 11:41	0.59	<1	<2	7.9	<1	0.48
2024-04-09 10:28	0.82	<1	<2	9.8	<1	0.32
2024-04-12 09:56	0.44	<1	<2	8.1	<1	0.25
2024-04-16 10:45	0.85	<1	<2	8.7	<1	0.28
2024-04-22 08:31	0.48	<1	<2	9.5	<1	0.3
2024-05-03 10:34	0.61	<1	<2	9	<1	0.3
2024-05-08 07:40	0.43	<1	<2	10.9	<1	0.25
2024-05-14 11:25	0.82	<1	2	12	<1	0.26
2024-05-23 11:50	0.46	<1	<2	11.1	<1	0.37
2024-05-28 11:46	0.65	<1	2	9.9	<1	0.3
2024-06-05 10:28	0.82	<1	6	12	<1	0.3
2024-06-06 10:32	0.93	<1	<2	12	<1	0.23
2024-06-12 10:26	0.88	<1	<2	13	<1	0.4
2024-06-20 10:23	0.83	<1	14	14	<1	0.23
2024-06-25 11:40	0.76	<1	<2	14	<1	0.24
2024-07-05 10:25	0.65	<1	<2	13	<1	0.27
2024-07-12 08:25	0.42	<1	4	13.6	<1	0.2
2024-07-18 12:22	0.62	<1	2	13	<1	0.21
2024-07-22 12:08	0.76	<1	2	13.5	<1	0.22
2024-07-31 10:00	0.8	<1	<2	12.6	<1	0.2
2024-08-09 10:44	0.74	<1	2	13.8	<1	0.17
2024-08-15 07:21	0.77	<1	<2	13.5	<1	0.18
2024-08-21 10:13	0.67	<1	2	13.6	<1	0.27
2024-08-28 10:24	0.89	<1	4	13.4	<1	0.31
2024-09-05 10:33	1.06	<1	2	13.9	<1	0.17
2024-09-11 11:32	0.72	<1	<2	13.9	<1	0.2
2024-09-19 09:22	0.72	<1	2	14.5	<1	0.3
2024-09-23 12:25	0.81	<1	2	14.1	<1	0.24
2024-10-04 09:55	0.77	<1	6	14.9	<1	0.25
2024-10-10 10:32	0.92	<1	14	14.9	<1	0.22
2024-10-17 10:55	0.88	<1	<2	14	<1	0.22

2024 Annual Water Quality Report

2024-10-20 08:31	0.91	<1	2	12.2	<1	11
2024-10-21 11:48	1.18	<1	92	11.1	<1	8.3
2024-10-22 11:36	1.05	<1	<2	12	<1	5.7
2024-10-23 08:19	1.18	<1	<2	12	<1	5.3
2024-10-24 12:15	1.26	<1	<2	12.1	<1	3.2
2024-10-31 12:06	0.9	<1	<2	10.9	<1	1.6
2024-11-03 11:46	0.55	<1	<2	11.3	<1	1.1
2024-11-15 06:29	0.97	<1	4	10.5	<1	1.1
2024-11-28 11:45	0.84	<1	<2	9.7	<1	0.42
2024-12-05 11:11	0.62	<1	<2	7.8	<1	0.43
2024-12-11 11:17	0.59	<1	<2	8	<1	0.44
2024-12-20 09:27	0.68	<1	NA	7.9	<1	0.67
2024-12-30 08:03	0.92	<1	NA	8.6	<1	0.38

PMY 514 – 200 Parkside Drive

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 10:41	0.29	<1	2	8.1	<1	0.46
2024-01-11 10:22	0.31	<1	<2	7.6	<1	0.47
2024-01-12 10:52	0.24	<1	<2	6.9	<1	0.49
2024-01-23 11:12	0.36	<1	<2	5.7	<1	0.45
2024-01-25 10:29	0.36	<1	<2	5.9	<1	0.55
2024-01-29 10:22	0.47	<1	14	6.1	<1	0.48
2024-01-30 10:12	0.23	<1	4	7.6	<1	0.61
2024-02-01 12:22	0.25	<1	<2	6.6	<1	0.5
2024-02-07 10:41	0.23	<1	<2	7	<1	0.39
2024-02-15 11:18	0.13	<1	<2	7.1	<1	0.51
2024-02-22 12:41	0.3	<1	<2	7.1	<1	0.31
2024-03-01 09:58	0.16	<1	<2	6.7	<1	0.35
2024-03-07 11:39	0.2	<1	2	6.2	<1	0.32
2024-03-12 09:48	0.44	<1	<2	7.2	<1	0.35
2024-03-14 11:27	0.21	<1	<2	6.2	<1	0.33
2024-03-21 11:31	0.24	<1	<2	7.8	<1	0.39
2024-03-22 10:14	0.23	<1	<2	7.8	<1	0.34
2024-03-26 09:53	0.2	<1	<2	7.8	<1	0.28
2024-04-03 11:02	0.27	<1	<2	7.8	<1	0.44
2024-04-09 09:40	0.2	<1	<2	7.8	<1	0.34
2024-04-12 10:53	0.29	<1	<2	7.8	<1	0.27
2024-04-16 09:41	0.32	<1	<2	7.9	<1	0.23
2024-04-22 09:32	0.21	<1	<2	8.6	<1	0.3
2024-05-02 12:18	0.27	<1	10	11.8	<1	0.23
2024-05-08 09:32	0.16	<1	<2	9.2	<1	0.24
2024-05-14 10:37	0.26	<1	2	11.1	<1	0.24
2024-05-16 08:59	0.34	<1	<2	11	<1	0.28
2024-05-23 11:01	0.18	<1	16	11.3	<1	0.25

2024 Annual Water Quality Report

2024-05-28 10:55	0.2	<1	<2	10.8	<1	0.24
2024-06-05 09:31	0.08	<1	170	11	<1	0.25
2024-06-06 09:30	0.17	<1	<2	11.4	<1	0.24
2024-06-12 09:30	0.19	<1	22	12	<1	0.23
2024-06-20 09:30	0.11	<1	22	12.8	<1	0.26
2024-06-24 11:52	0.17	<1	<2	13.6	<1	0.25
2024-06-25 10:41	0.15	<1	<2	12.2	<1	0.22
2024-07-05 10:13	0.23	<1	10	12.7	<1	0.24
2024-07-11 11:31	0.05	<1	<2	13.3	<1	0.22
2024-07-18 11:30	0.2	<1	32	14.9	<1	0.24
2024-07-22 11:26	0.2	<1	6	13.6	<1	0.25
2024-07-31 09:04	0.04	<1	80	16.1	<1	0.24
2024-08-09 10:00	0.19	<1	10	14.3	<1	0.18
2024-08-13 12:19	0.18	<1	4	15.6	<1	0.18
2024-08-15 11:52	0.37	<1	<2	15.2	<1	0.17
2024-08-21 09:22	0.14	<1	8	16.2	<1	0.2
2024-08-28 09:21	0.11	<1	58	16.2	<1	0.24
2024-09-05 09:32	0.12	<1	78	15.7	<1	0.2
2024-09-11 10:44	0.23	<1	<2	15.2	<1	0.17
2024-09-16 12:38	0.13	<1	50	16.5	<1	0.2
2024-09-23 11:18	0.25	<1	44	16.9	<1	0.25
2024-09-25 09:23	0.15	<1	<2	15.4	<1	0.27
2024-10-03 12:47	0.17	<1	2	15.3	<1	0.2
2024-10-10 09:41	0.07	<1	<2	14.5	<1	0.2
2024-10-17 09:48	0.04	<1	18	14.3	<1	0.22
2024-10-24 11:14	0	<1	44	13.3	<1	2.2
2024-10-31 10:11	0.17	<1	10	12.5	<1	0.97
2024-11-03 10:37	0.08	<1	2	12	<1	0.79
2024-11-23 09:20	0.15	<1	14	10.5	<1	0.61
2024-11-28 10:48	0	<1	10	10	<1	0.42
2024-12-05 10:28	0.22	<1	<2	8.2	<1	8
2024-12-06 08:52	0.15	<1	58	8.9	<1	0.37
2024-12-11 10:24	0.18	<1	32	8.7	<1	0.37
2024-12-20 08:46	0.17	<1	NA	8.4	<1	0.47
2024-12-24 12:26	0.34	<1	NA	8.9	<1	0.5

PMY 515 – Hickory Reservoir

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 10:10	0.42	<1	<2	7.6	<1	0.57
2024-01-23 11:48	0.49	<1	<2	5.1	<1	0.49
2024-01-30 09:45	0.57	<1	<2	7.4	<1	0.73
2024-02-07 11:41	0.37	<1	<2	6.1	<1	0.49
2024-02-15 12:10	0.39	<1	<2	5.8	<1	0.53
2024-02-22 12:20	0.44	<1	<2	6.2	<1	0.44
2024-03-01 10:44	0.31	<1	<2	5.6	<1	0.42
2024-03-07 11:02	0.33	<1	<2	5	<1	0.42
2024-03-14 12:44	0.37	<1	2	5.3	<1	0.37
2024-03-21 11:00	0.33	<1	<2	6.8	<1	0.39
2024-03-26 10:32	0.4	<1	<2	6.3	<1	0.36
2024-04-03 10:35	0.49	<1	<2	6.6	<1	0.33
2024-04-09 10:13	0.3	<1	<2	6.6	<1	0.36
2024-04-12 11:48	0.99	<1	<2	6.5	<1	0.28
2024-04-16 10:11	0.27	<1	<2	7.2	<1	0.28
2024-04-22 10:53	0.45	<1	2	7.5	<1	0.32
2024-05-08 10:15	0.38	<1	<2	12.3	<1	0.34
2024-05-14 10:13	0.8	<1	<2	9.4	<1	0.28
2024-05-23 10:34	0.55	<1	<2	9.9	<1	0.33
2024-05-28 10:22	0.35	<1	<2	8.8	<1	0.33
2024-06-05 10:05	0.35	<1	4	8.3	<1	0.36
2024-06-06 09:54	0.32	<1	<2	9	<1	0.25
2024-06-12 09:58	0.36	<1	<2	10.3	<1	0.39
2024-06-20 09:55	0.33	<1	2	10.4	<1	0.29
2024-06-25 10:14	0.24	<1	<2	10.4	<1	0.31
2024-07-05 09:43	0.29	<1	<2	11	<1	0.27
2024-07-12 08:55	0.3	<1	<2	11.5	<1	0.25
2024-07-18 11:00	0.22	<1	24	12.1	<1	0.24
2024-07-22 10:55	0.2	<1	<2	12.6	<1	0.26
2024-07-31 09:44	0.18	<1	<2	12.4	<1	0.19
2024-08-09 09:39	0.22	<1	12	13.3	<1	0.2
2024-08-13 11:51	0.25	<1	2	13.3	<1	0.19
2024-08-21 09:52	0.25	<1	4	13.4	<1	0.21
2024-08-28 09:49	0.35	<1	14	13.5	<1	0.29
2024-09-05 10:16	0.29	<1	14	13.9	<1	0.23
2024-09-11 10:25	0.36	<1	<2	14.4	<1	0.19
2024-09-19 08:22	0.41	<1	2	13.9	<1	0.28
2024-09-23 10:50	0.36	<1	<2	14	<1	0.29
2024-10-03 12:17	0.47	<1	<2	13.5	<1	0.25
2024-10-10 10:09	0.29	<1	<2	13.3	<1	0.23
2024-10-17 10:22	0.26	<1	<2	12.9	<1	0.25
2024-10-24 11:46	0.16	<1	<2	12	<1	2.9
2024-10-30 11:44	0.35	<1	2	10.9	<1	2.1
2024-11-03 11:15	0.34	<1	<2	11	<1	1.3

2024 Annual Water Quality Report

2024-11-15 09:32	0.6	<1	<2	10	<1	1.1
2024-11-23 08:58	0.4	<1	<2	8.8	<1	0.65
2024-11-28 11:17	0.59	<1	<2	8.7	<1	0.58
2024-12-05 10:08	0.52	<1	<2	7.8	<1	0.48
2024-12-11 10:04	0.47	<1	<2	7.7	<1	0.48
2024-12-20 08:29	0.46	<1	NA	7.3	<1	0.54
2024-12-24 12:05	0.68	<1	NA	7.3	<1	0.61

PMY 516 – 2424 St. Johns Street (Kyle St & Spring St)

Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 11:55	0.5	<1	<2	8.4	<1	0.53
2024-01-11 08:08	0.46	<1	2	7	<1	0.85
2024-01-23 13:40	0.41	<1	<2	3.7	<1	0.8
2024-01-30 12:24	0.59	<1	<2	6.3	<1	0.56
2024-02-07 07:47	0.18	<1	2	6.8	<1	0.53
2024-02-15 08:50	0.33	<1	2	5.6	<1	0.44
2024-02-22 07:55	0.51	<1	<2	6.6	<1	0.35
2024-03-01 08:27	0.45	<1	32	6	<1	0.4
2024-03-07 13:33	0.65	<1	2	5.5	<1	0.48
2024-03-14 13:42	0.55	<1	2	6	<1	0.43
2024-03-22 11:04	0.52	<1	<2	7.4	<1	0.54
2024-03-26 07:38	0.33	<1	<2	7.2	<1	0.38
2024-04-03 12:11	0.48	<1	<2	9.1	<1	0.39
2024-04-09 07:33	0.37	<1	<2	8	<1	0.34
2024-04-12 13:32	0.6	<1	2	8.2	<1	0.33
2024-04-16 07:31	0.37	<1	<2	8.4	<1	0.25
2024-04-19 10:59	0.16	<1	<2	9.6	<1	0.28
2024-04-25 13:15	0.23	<1	<2	9.7	<1	0.27
2024-05-03 11:06	0.42	<1	<2	12	<1	0.35
2024-05-08 12:33	0.45	<1	2	11.3	<1	0.38
2024-05-16 10:00	0.4	<1	<2	13	<1	0.28
2024-05-17 08:40	0.37	<1	<2	10.6	<1	0.34
2024-05-24 07:34	0.27	<1	<2	12	<1	0.34
2024-05-28 12:58	0.18	<1	<2	11.7	<1	0.52
2024-06-05 07:24	0.24	<1	<2	11.6	<1	0.29
2024-06-06 07:43	0.31	<1	<2	12.3	<1	0.25
2024-06-12 07:31	0.26	<1	<2	12.5	<1	0.27
2024-06-20 07:37	0.22	<1	<2	13.7	<1	0.27
2024-06-25 12:06	0.57	<1	<2	11.7	<1	0.34
2024-07-05 10:46	0.24	<1	<2	16	<1	0.19
2024-07-11 08:03	0.29	<1	4	12.3	<1	0.39
2024-07-18 13:22	0.28	<1	2	14.8	<1	0.23
2024-07-22 12:43	0.57	<1	<2	14.5	<1	0.31
2024-07-31 07:24	0.21	<1	20	16	<1	0.16

2024 Annual Water Quality Report

2024-08-09 11:09	0.41	<1	<2	13.7	<1	0.18
2024-08-15 07:36	0.37	<1	<2	14.4	<1	0.15
2024-08-21 07:23	0.11	<1	<2	17	<1	0.18
2024-08-28 07:37	0.17	<1	<2	18.4	<1	0.22
2024-09-05 07:42	0.15	<1	<2	20.7	<1	0.24
2024-09-11 12:00	0.38	<1	<2	15.9	<1	0.3
2024-09-19 09:47	0.24	<1	2	15.5	<1	0.16
2024-09-23 12:57	0.21	<1	2	15.4	<1	0.15
2024-10-10 07:26	0.15	<1	<2	15.6	<1	0.2
2024-10-17 07:48	0.15	<1	<2	15.4	<1	0.49
2024-10-24 09:15	0.3	<1	2	13	<1	2.6
2024-11-03 08:13	0.45	<1	<2	11.3	<1	1.6
2024-11-14 08:04	0.24	<1	<2	11.1	<1	1.2
2024-11-23 10:22	0.35	<1	<2	11	<1	1.2
2024-11-28 08:00	0.72	<1	<2	8.4	<1	0.55
2024-11-29 13:05	0.33	<1	6	8.4	<1	1
2024-12-05 11:32	0.33	<1	16	7.8	<1	0.78
2024-12-11 11:40	0.4	<1	<2	7.7	<1	0.95
2024-12-20 09:55	0.45	<1	NA	7.9	<1	0.91
2024-12-30 07:38	0.3	<1	NA	7.3	<1	0.58

PMY 517 – David Avenue & Heritage Mountain Blvd


Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
2024-01-04 10:31	0.33	<1	<2	8	<1	0.47
2024-01-11 10:45	0.62	<1	<2	6.6	<1	0.47
2024-01-23 11:21	0.53	<1	2	5.3	<1	0.5
2024-01-30 10:07	0.45	<1	30	7.8	<1	0.7
2024-02-01 12:28	0.23	<1	4	6.2	<1	0.52
2024-02-07 12:01	0.22	<1	<2	6.3	<1	0.48
2024-02-16 09:51	0.4	<1	2	4.3	<1	0.45
2024-02-22 12:38	0.33	<1	6	7.5	<1	0.3
2024-03-07 11:14	0.27	<1	<2	5.5	<1	0.44
2024-03-14 11:49	0.25	<1	<2	5.3	<1	0.34
2024-03-21 11:18	0.49	<1	<2	6.4	<1	0.36
2024-03-26 10:50	0.37	<1	<2	6.3	<1	0.53
2024-04-03 10:53	0.39	<1	<2	6.4	<1	0.36
2024-04-12 11:01	0.29	<1	<2	8.3	<1	0.28
2024-04-16 10:37	0.37	<1	<2	6.5	<1	0.27
2024-04-22 09:43	0.25	<1	4	8	<1	0.27
2024-05-08 09:52	0.19	<1	<2	11.9	<1	0.24
2024-05-14 10:28	0.38	<1	<2	8.9	<1	0.38
2024-05-23 10:47	0.22	<1	<2	8.4	<1	0.29
2024-05-28 10:47	0.24	<1	<2	10.1	<1	0.32
2024-06-05 10:20	0.28	<1	18	8.7	<1	0.32

2024 Annual Water Quality Report

2024-06-06 10:22	0.22	<1	<2	8.7	<1	0.22
2024-06-12 10:13	0.25	<1	<2	10.2	<1	0.3
2024-06-20 10:11	0.2	<1	<2	10.1	<1	0.27
2024-06-25 10:29	0.25	<1	20	10.6	<1	0.29
2024-07-05 10:04	0.25	<1	36	12.9	<1	0.27
2024-07-11 11:23	0.25	<1	<2	11.3	<1	0.26
2024-07-18 11:21	0.2	<1	<2	11.7	<1	0.22
2024-07-22 11:12	0.23	<1	<2	11.8	<1	0.24
2024-08-09 09:52	0.28	<1	18	12.6	<1	0.39
2024-08-13 12:10	0.4	<1	<2	12.9	<1	0.19
2024-08-21 10:05	0.28	<1	12	13.1	<1	0.23
2024-08-28 10:13	0.26	<1	36	13.5	<1	0.2
2024-09-05 09:51	0.2	<1	40	13.5	<1	0.22
2024-09-11 10:38	0.25	<1	<2	13.6	<1	0.27
2024-09-19 08:37	0.3	<1	4	13.7	<1	0.27
2024-09-23 11:04	0.27	<1	<2	13.8	<1	0.32
2024-10-03 12:39	0.2	<1	<2	13.3	<1	0.41
2024-10-10 10:24	0.18	<1	<2	13.1	<1	0.22
2024-10-17 10:36	0.29	<1	<2	12.6	<1	0.33
2024-10-24 12:04	0.26	<1	<2	11.8	<1	3
2024-10-31 10:04	0.25	<1	<2	11.1	<1	1.3
2024-11-03 11:36	0.09	<1	6	11	<1	0.96
2024-11-28 11:32	0.09	<1	68	8.8	<1	0.48
2024-12-05 10:20	0.21	<1	8	8	<1	1.2
2024-12-11 10:15	0.22	<1	100	7.8	<1	0.44
2024-12-20 08:41	0.26	<1	NA	7.8	<1	0.94
2024-12-24 12:20	0.21	<1	NA	7.8	<1	0.45

Appendix #2

PORT MOODY WATER SAMPLING LOCATIONS

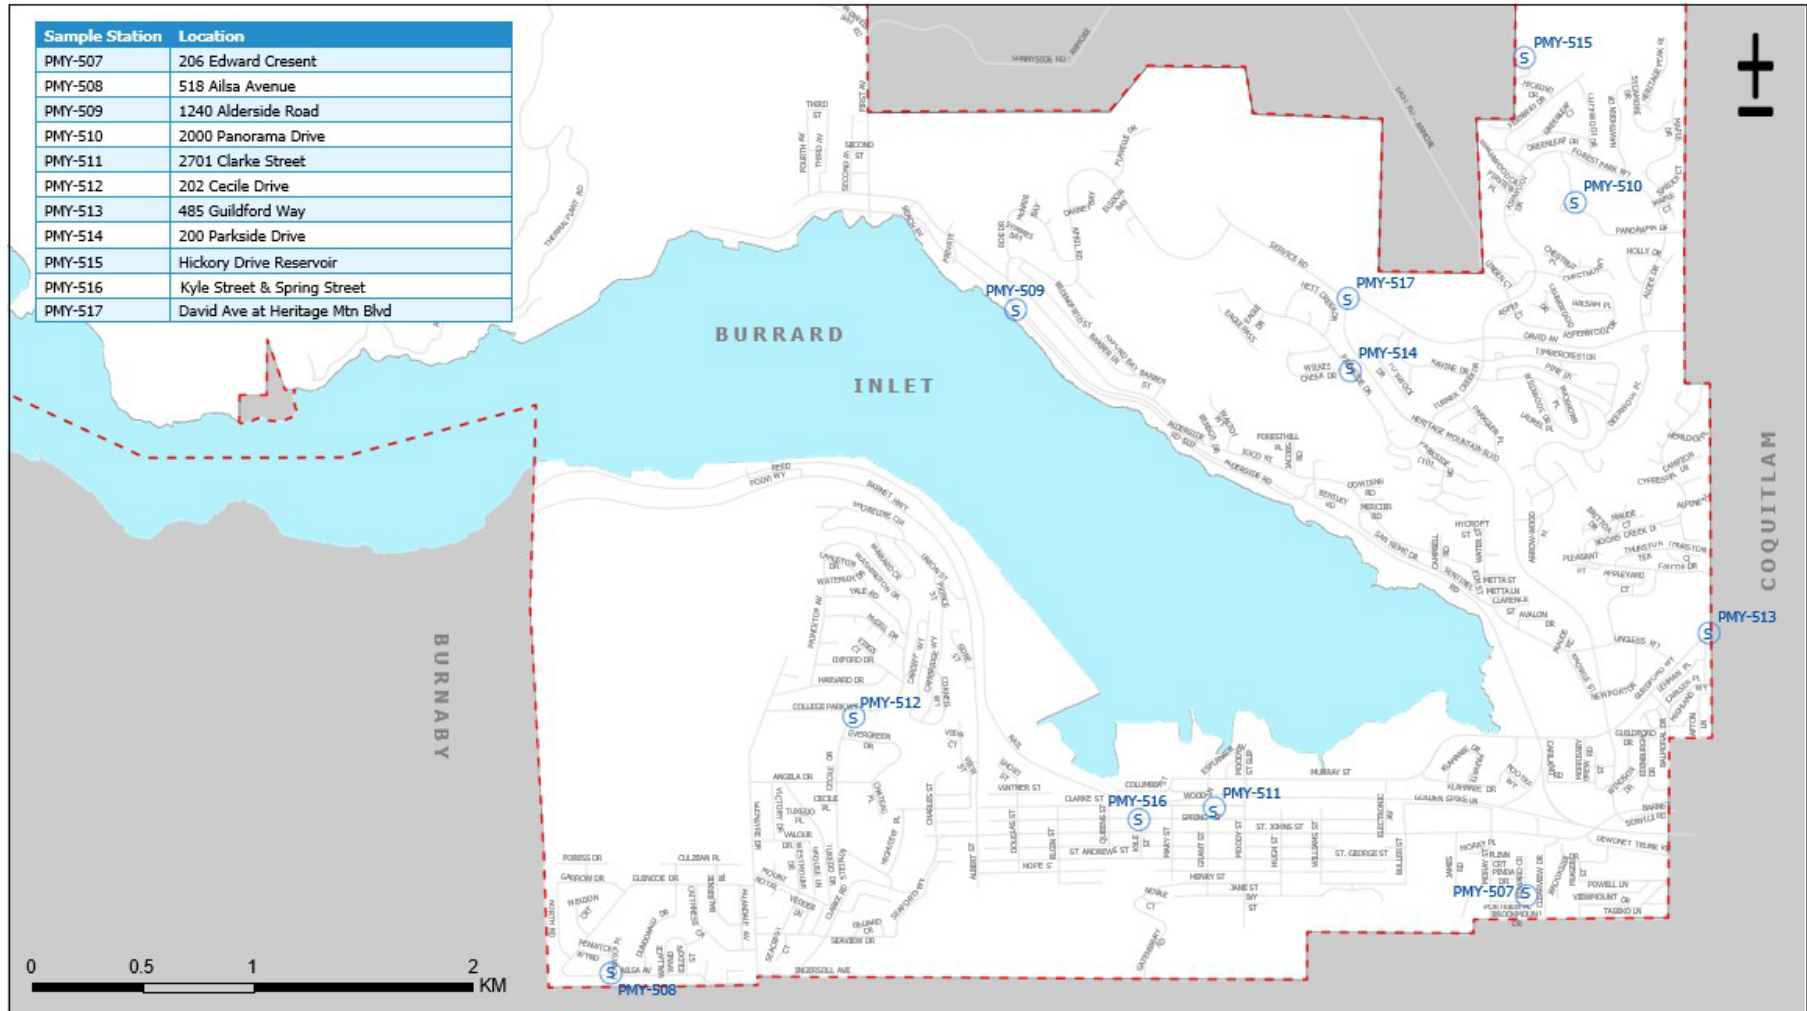

PORT MOODY
CITY OF THE ARTS

DISCLAIMER: THE CITY OF PORT MOODY MAKES NO REPRESENTATION OR WARRANTY EXPRESSED OR IMPLIED WITH RESPECT TO THE ACCURACY, CORRECTNESS OR APPROPRIATENESS OF THE INFORMATION CONTAINED HEREON.

Date Printed: 5/28/2024

Appendix #3

Metals Monitoring

2024 Metals Monitoring Data for GCDWQ Parameters

January-June 2024

		PMY-507	PMY-508	PMY-509	PMY-510	PMY-512
	Sample Location	206 Edward Crescent	518 Ailsa Avenue	1240 Alderside Road	2000 Panorama Drive	202 Cecile Drive
	Sample Date	4/16/2024 8:17	4/16/2024 6:57	4/16/2024 9:30	4/16/2024 9:58	4/16/2024 7:10
Aluminum Total	µg/L	73	29	73	80	30
Antimony Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Arsenic Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Barium Total	µg/L	2.0	2.9	2.3	2.0	2.7
Boron Total	µg/L	<10	<10	<10	<10	<10
Cadmium Total	µg/L	<0.2	<0.2	<0.2	<0.2	<0.2
Calcium Total	µg/L	925	8240	1010	835	7700
Chromium Total	µg/L	<0.05	<0.05	<0.05	1.05	<0.05
Cobalt Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Copper Total	µg/L	0.6	0.6	0.5	12.8	4.7
Iron Total	µg/L	40	13	45	47	16
Lead Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Magnesium Total	µg/L	86	217	94	95	211
Manganese Total	µg/L	2.2	3.0	1.6	3.1	4.9
Mercury Total	µg/L	<0.05	<0.05	<0.05	<0.05	<0.05
Molybdenum Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Nickel Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Potassium Total	µg/L	112	160	115	115	154
Selenium Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Silver Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Sodium Total	µg/L	10000	2460	9850	10300	2960
Zinc Total	µg/L	<3.0	<3.0	<3.0	<3.0	<3.0

July-December 2024

	Sample Location	PMY-507	PMY-508	PMY-509	PMY-510	PMY-512
		206 Edward Crescent	518 Ailsa Avenue	1240 Alderside Road	2000 Panorama Drive	202 Cecile Drive
		10/10/2024 8:13	10/10/2024 7:00	10/10/2024 9:29	10/10/2024 9:56	10/10/2024 7:11
Aluminum Total	µg/L	65	38	64	60	36
Antimony Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Arsenic Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Barium Total	µg/L	2.2	2.5	2.6	2.5	3.1
Boron Total	µg/L	<10	<10	<10	<10	<10
Cadmium Total	µg/L	<0.2	<0.2	<0.2	<0.2	<0.2
Calcium Total	µg/L	1050	5620	1170	1050	5870
Chromium Total	µg/L	<0.05	<0.05	<0.05	<0.05	<0.05
Cobalt Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Copper Total	µg/L	0.7	1.4	0.6	12.3	4.8
Iron Total	µg/L	47	48	44	47	59
Lead Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Magnesium Total	µg/L	82	218	91	92	236
Manganese Total	µg/L	2	7.2	1.1	2.8	7.6
Mercury Total	µg/L	<0.05	<0.05	<0.05	<0.05	<0.05
Molybdenum Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Nickel Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Potassium Total	µg/L	123	212	127	131	220
Selenium Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Silver Total	µg/L	<0.5	<0.5	<0.5	<0.5	<0.5
Sodium Total	µg/L	10900	5160	11500	11300	4910
Zinc Total	µg/L	<3.0	<3.0	<3.0	<3.0	<3.0

Appendix #4

Disinfection By-Product Monitoring

2024 Trihalomethane Monitoring Results

Station	Date Sampled	THM (ppb)				
		Bromodichloromethane (MAC 16 ppb)	Bromoform	Chlorodibromomethane	Chloroform	Total Trihalomethanes (MAC 100 ppb)
PMY-506 22 Crawford Bay	1/29/2024	<1	<1	<1	28	28
	4/23/2024	<1	<1	<1	22	24
	9/11/2024	<1	<1	<1	31	32
	11/28/2024	<1	<1	<1	26	26
PMY-507 206 Edward Crescent	1/29/2024	<1	<1	<1	25	26
	4/23/2024	<1	<1	<1	21	22
	9/11/2024	1	<1	<1	28	30
	11/28/2024	<1	<1	<1	25	27
PMY-508 518 Ailsa Ave	1/29/2024	<1	<1	<1	19	20
	4/23/2024	<1	<1	<1	33	34
	9/11/2024	1	<1	<1	38	40
	11/28/2024	<1	<1	<1	34	35

2024 Annual Water Quality Report
2024 Haloacetic Acid Monitoring Results

Station	Date Sampled	HAA (ppb)					
		Dibromoacetic Acid	Dichloroacetic Acid	Monobromoacetic Acid	Monochloroacetic Acid	Trichloroacetic Acid	Total Haloacetic Acid (MAC 80 ppb)
PMY-506 22 Crawford Bay	1/29/2024	<0.5	2.3	<0.5	<0.5	9.9	12
	4/23/2024	<0.5	0.7	<0.5	<0.5	7.6	8.3
	9/11/2024	<0.5	1	<0.5	<0.5	9.5	11
	11/28/2024	<0.5	0.8	<0.5	<0.5	9.1	9.9
PMY-507 206 Edward Crescent	1/29/2024	<0.5	5.9	<0.5	<0.5	12	18
	4/23/2024	<0.5	4.1	<0.5	<0.5	6.1	10
	9/11/2024	<0.5	5	<0.5	<0.5	14	19
	11/28/2024	<0.5	4.9	<0.5	<0.5	11	16
PMY-508 518 Ailsa Ave	1/29/2024	<0.5	5	<0.5	<0.5	6.9	12
	4/23/2024	<0.5	12	<0.5	<0.5	6.1	10
	9/11/2024	<0.5	2.4	<0.5	<0.5	14	16
	11/28/2024	<0.5	2.5	<0.5	<0.5	11	13

Appendix #5

Vinyl Chloride Monitoring

2024 Vinyl Chloride Monitoring Results

Address	Sample Reported Name	Sampled Date	Vinyl Chloride (µg/L)
100 Klahanie Drive	PMY-1 (Hydrant #2129)	6/12/2024	<1
300 Klahanie Drive	PMY-2 (Hydrant # 2131)	6/12/2024	<1
100 Klahanie Drive	PMY-1 (Hydrant #2129)	11/18/2024	<1
300 Klahanie Drive	PMY-2 (Hydrant # 2131)	11/18/2024	<1